# Miniature resistance thermometer Model TR33, thread-mounted

WIKA data sheet TE 60.33

### **Applications**

- Machine building, plant and vessel construction
- Propulsion technology, hydraulics
- General applications

### **Special features**

- Very compact design, high vibration resistance and Fast response time
- With direct sensor output (Pt100, Pt1000 in 2-, 3- or 4-wire) or integrated transmitter with output signal 4 ... 20 mA
- Individually parameterisable for integrated transmitter with free PC configuration software WIKAsoft-TT
- Sensor element with accuracy class A per IEC 60751
- EMC conformity in accordance with NAMUR NE21



Fig. left: Resistance thermometer, model TR33 Fig. right: Adapter M12 x 1 for angular connector-DIN EN 175301-803

### Description

Resistance thermometers of this series are used as universal thermometers for the measurement of liquid and gaseous media in the range of -50  $\dots$  +250 °C.

They can be used for pressures up to 140 bar with sensor diameter 3 mm and up to 270 bar with sensor diameter 6 mm, dependent on the instrument version. All electrical components are protected against humidity (IP 67 or IP 69K) and designed to withstand vibration (20 g, depending on the instrument version).

The resistance thermometer is available with direct sensor output or integrated transmitter, which can be configured individually via the PC configuration software WIKAsoft-TT. Measuring range, damping, fault signal per NAMUR NE43 and TAG no. can be adjusted. Insertion length, process connection, sensor and connection method can each be selected for the respective application from the order information. The model TR33 resistance thermometer consists of a thermowell with fixed process connection and is screwed directly into the process. The electrical connection is made via an M12 x 1 circular connector. An adapter for electrical connection with angular connector per DIN EN 175301-803 is optionally available.

WIKA data sheet TE 60.33 · 03/2014

Data sheets showing similar products and accessories: Resistance thermometer, compact design; model TR30; see data sheet TE 60.30 OEM screw-in thermometer with plug connection; model TF35; see data sheet TE 67.10



Page 1 of 7

### Sensor

The sensor is located in the tip of the thermometer.

The resistance thermometers of the series TR33 are designed for direct installation into the process. Using it in an additional thermowell makes no sense.

| Sensor diameter in mm                        | Proces<br>G ¼ B | ss conne<br>G ¾ B | ction<br>G ½ B       | 1⁄4 NPT  | - 1∕2 N | PT I | M12 x 1. | 5 M2 | 0 x 1.5 |
|--|-----------------|-------------------|----------------------|----------|---------|------|----------|------|---------|
| 3  | х               | х                 | х                    | х        | Х       | 3    | ĸ        | Х    |         |
| 6  | х               | х                 | х                    | х        | х       | 3    | x        | х    |         |
| Sensor tube leng<br>Sensor diameter<br>in mm |                 |                   | h U1 in mi<br>00 120 | n<br>150 | 200     | 250  | 300      | 350  | 400     |
| 3  | х               |                   | -                    | -        | -       | -    | -        | -    | -       |
| 6  | х               | x x               | х                    | х        | х       | х    | х        | х    | х       |

### **Specifications**

| Thermometer with transmitter and output signal 4 20 mA |  |  |  |  |
|--|--|--|--|--|
| Temperature range                                      | without neck tube -50 +150 °C (-58 +302 °F)<br>with neck tube -50 +250 °C (-58 +482 °F) <sup>1)</sup>  |  |  |  |
| Measuring element                                      | Pt1000   |  |  |  |
| Connection method                                      | 2-wire   |  |  |  |
| Tolerance value of the measuring element per IEC 60751 | Class A  |  |  |  |
| Measuring deviation of the transmitter per IEC 60770   | 0.25 K   |  |  |  |
| Total measuring deviation according to IEC 60770       | Measuring deviation of the measuring element + the transmitter   |  |  |  |
| Measuring span   | minimum 20 K, maximum 300 K  |  |  |  |
| Basic configuration                                    | Measuring range 0 150 °C, other measuring ranges are adjustable  |  |  |  |
| Analogue output  | 4 20 mA, 2-wire  |  |  |  |
| Linearisation  | linear to temperature per IEC 60751  |  |  |  |
| Linearisation error                                    | ±0.1 % <sup>2)</sup>   |  |  |  |
| Switch-on delay, electrical                            | max.4 s  |  |  |  |
| (time before the first measured value)                 |  |  |  |  |
| Warming-up period                                      | After approx. 4 minutes the instrument will function to the specified technical data (accuracy).   |  |  |  |
| Current signal for fault signal                        | configurable in accordance with NAMUR NE43<br>downscale $\leq$ 3.6 mA<br>upscale $\geq$ 21.0 mA  |  |  |  |
| Sensor short-circuit                                   | not configurable, per NAMUR NE43 downscale ≤ 3.6 mA  |  |  |  |
| Sensor current   | < 0.3 mA (Self-heating can be neglected.)  |  |  |  |
| Load RA  | $R_A \le (U_B - 10 \text{ V}) / 23 \text{ A with } R_A \text{ in } \Omega \text{ and } U_B \text{ in } V$  |  |  |  |
| Effect of load   | ±0.05 % / 100 Ω  |  |  |  |
| Power supply UB  | DC 10 30 V   |  |  |  |
| Max. permissible residual ripple                       | 10 % generated by U <sub>B</sub> < 3 % ripple of the output current  |  |  |  |
| Power supply input                                     | protected against reverse polarity   |  |  |  |
| Power supply effect (depending on the power supply UB) | ±0.025 % / V   |  |  |  |
| Influence of the ambient temperature                   | 0.1 % of span / 10 K T <sub>amb</sub>  |  |  |  |
| Electromagnetic compatibility (EMC)                    | 2004/108/EC, EN 61326 emission (group 1, class B) and interference immunity (industrial application) <sup>3)</sup> , configuration at 20 % of the full measuring range |  |  |  |
| Temperature units                                      | configurable °C, °F, K   |  |  |  |
| Info data  | TAG No., description and user message can be stored in transmitter   |  |  |  |
| Configuration and calibration data                     | permanently stored   |  |  |  |
| Electrical connection                                  | M12 x 1, 4-pin circular connector  |  |  |  |

Readings in % refer to the measuring span

For a correct determination of the overall measuring error, both sensor and transmitter measuring deviations have to be considered.

1) Protect the temperature transmitter therefore from temperatures over 85 °C (185 °F).

3) ±0.2 % for measuring ranges with a lower limit less than 0 °C (32 °F)

4) Use resistance thermometers with shielded cable and ground the shield on at least one end of the lead, if the lines are longer than 30 m or leave the building. Operate the instrument grounded.

| Thermometer with direct sensor output with Pt100 and Pt1000 |   |  |  |  |
|---|---|--|--|--|
| Temperature range   | without neck tube -50 +150 °C (-58 +302 °F)<br>with neck tube -50 +250 °C (-58 +482 °F)   |  |  |  |
| Temperature at the plug                                     | max. 85 °C (185 °F)   |  |  |  |
| Measuring element   | <ul> <li>Pt100 (measuring current: 0.1 1.0 mA)</li> <li>Pt1000 (measuring current: 0.1 0.3 mA)</li> </ul>   |  |  |  |
| Connection method   | <ul> <li>2-wire The lead resistance is recorded as an error in the measurement.</li> <li>3-wire With a cable length of 30 m or longer, measuring errors can occur.</li> <li>4-wire The lead resistance can be neglected.</li> </ul> |  |  |  |
| Tolerance value of the measuring element per IEC 60751      | <ul> <li>Class A</li> <li>Class B at 2-wire</li> </ul>  |  |  |  |
| Electrical connection                                       | M12 x 1, 4-pin circular connector   |  |  |  |

For detailed specifications for Pt sensors, see Technical information IN 00.17 at www.wika.com.


| Case                             |   |
|----------------------------------|---|
| Material                         | Stainless steel   |
| Ingress protection               |   |
| Case with connected plug         | IP 67 and IP 69K per IEC 60529/EN 60529   |
|                                  | The stated ingress protection only applies when plugged in using<br>mating connectors that have the appropriate ingress protection. |
| Coupler connector, not connected | IP 67 per IEC 60529/EN 60529  |
| Weight in kg                     | ca. 0.2 0.7 (depending on version)  |
| Dimensions                       | see "Dimensions in mm"  |

| Ambient conditions                                     |  |
|--|--|
| Ambient and storage temperature range                  | -40 +85 °C (-40 185 °F)  |
| Climate class per IEC 60654-1                          | Cx (-40 +85 °C, 5 95 % relative air humidity)  |
| Maximum permissible humidity per IEC 60068-2-30 var. 2 | relative humidity 100 %, condensation allowed  |
| Vibration per IEC 60068-2-6                            | 10 2,000 Hz, 20 g <sup>1)</sup> (amplitude)  |
| Shock  | IEC 60068-2-27   |
| Salt fog   | IEC 60068-2-11   |
| Electromagnetic compatibility (EMC)                    | 2004/108/EC, EN 61326 emission (group 1, class B) and interference immunity (industrial application) |


1) Depending on the instrument version

### **Dimensions in mm**

#### Process connection with parallel threads (or without process connection)

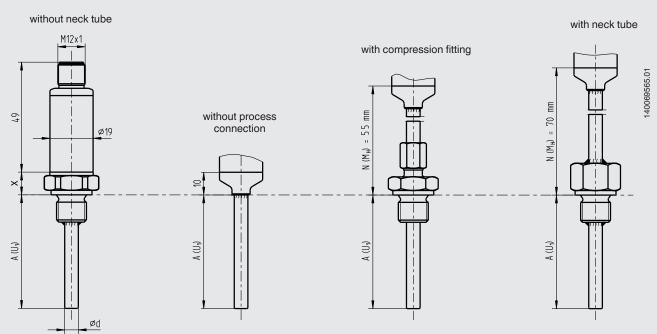

#### Process connection with tapered threads

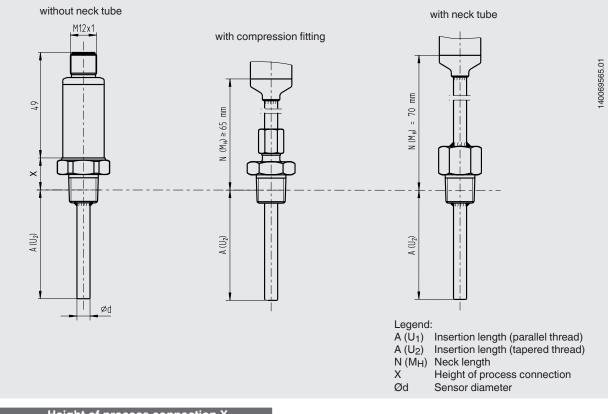

| Thread  | Height of process connection X |
|---------|--------------------------------|
| G 1/2   | 11                             |
| G 3/8   | 11                             |
| G 1/4   | 10                             |
| 1/4 NPT | 15                             |
| 1/2 NPT | 19                             |
| M12     | 11                             |
| M20     | 11                             |

### Accessories

#### **Configuration set**


| Model   | Special features   | Order no. |
|---|--|-----------|
| Programming unit<br>Model PU-448                                    | <ul> <li>Easy to use</li> <li>LED status display</li> <li>Compact design</li> <li>No further power supply is needed for either the programming unit or for the transmitter</li> </ul>  | 11606304  |
| Adapter cable M12 to PU-448   | Adapter cable for the connection of model TR33 resistance thermometer to the model PU-448 programming unit   | 14003193  |
| Transmitter adapter M12 x 1 for angular connector DIN EN 175301-803 | Adapter for the connection of a resistance thermometer with an angular connector<br>DIN EN 175301-803 with 4 20 mA output signal<br>M12 x 1 connector<br>$1 \xrightarrow{4=20 \text{ mA}} + \underbrace{4 \xrightarrow{0} \xrightarrow{1}}_{3 \xrightarrow{1} \xrightarrow{1} \xrightarrow{2}} 2$<br>$3 \xrightarrow{\text{mA}} 2$<br>Adapter for the connection of a resistance thermometer with an angular connector<br>angular connector<br>angular connector<br>Case: PA<br>Ambient temperature: -40 +115 °C<br>Union nut: Zinc diecast<br>Contacts: Copper-zinc alloy tin-coated<br>Dielectric strength: 500 V<br>Ingress protection: IP 65 | 14069503  |
| Pt adapter M12 x 1 for angular<br>connector DIN EN 175301-803       | Adapter for the connection of a resistance thermometer with an angular connector<br>DIN EN 175301-803 with direct resistance output signal<br>M12 x 1 connector<br>angular connector   | 14061115  |

## Configuration software WIKAsoft-TT


| ile Instrument ?              | ermomenter ::            |                               | :: Configuration :   |
|-------------------------------|--------------------------|-------------------------------|--|
| COM port                      | Configuration            | Adjustment Diagnostics        |  |
| Loading<br>instrument<br>data | Loading<br>configuration |                               |  |
| Transmitter model code        | TAG no                   | Description                   | User message   |
| TR33-T-E-A-M                  | 12345678                 |                               | -  |
| Serial number                 |                          |                               |  |
| Trölf                         | Input                    | Error signalling (NAMUR)      | an a   |
| Firmware                      | Measuring range          | Internal hardware error       |  |
| 1.0.0                         | 0 50 °C                  | up scale (21 mA)              |  |
| Sensor type                   | Damping [s]              | Configuration error           | the second secon |
| Pt1000                        | 0                        | up scale (21 mA)              |  |
|                               |                          |                               | 10   |
| Permissible ambient temp.     |                          | Sensor break                  |  |
| -4085 °C                      |                          | up scale (21 mA) 🔹            |  |
| Date of last configuration    |                          | Medium temperature outside MR |  |
| 18.03.2014                    |                          | up scale (21 mA) 👻            |  |
|                               |                          | Sensor short-circuit          |  |
|                               |                          | up scale (21 mA) -            |  |
|                               |                          |                               | Saving to the  |

Configuration software (multilingual) as download from www.wika.com

## Connecting PU-448 programming unit

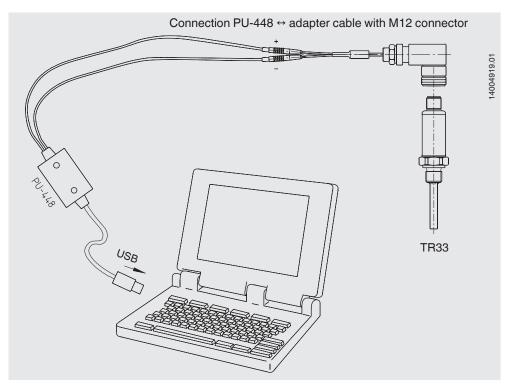


## **Electrical connection**

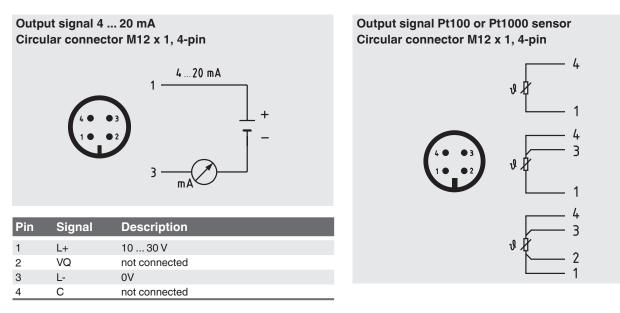

#### Load diagram

The permissible load depends on the loop supply voltage. For communication with the instrument with programming unit PU-448, a max. load of 350  $\Omega$  is admissible.

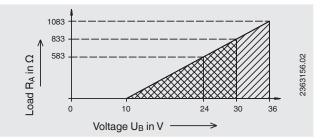

## **CE conformity**

#### EMC directive 1)

2004/108/EC, EN 61326 emission (group 1, class B) and interference immunity (industrial application)

1) Only for built-in transmitter

# **Certificates (option)**

| Certification type                | Measuring<br>accuracy | Material<br>certificate |
|-----------------------------------|-----------------------|-------------------------|
| 2.2 test report                   | х                     | х                       |
| 3.1 inspection certificate        | х                     | х                       |
| DKD/DAkkS calibration certificate | х                     | -                       |

The different certifications can be combined with each other.

Approvals and certificates, see website

#### **Ordering information**

Model / Output signal / Transmitter temperature unit / Process temperature / Transmitter initial value / Transmitter end value / Process connection / Sensor diameter / Sensor insertion length / Neck tube / Accessories

© 2013 WIKA Alexander Wiegand SE & Co. KG, all rights reserved. The specifications given in this document represent the state of engineering at the time of publishing. We reserve the right to make modifications to the specifications and materials.

WIKA data sheet TE 60.33 · 03/2014

Page 7 of 7



WIKA Alexander Wiegand SE & Co. KG Alexander-Wiegand-Straße 30 63911 Klingenberg/Germany Tel. +49 9372 132-0 Fax +49 9372 132-406 info@wika.de www.wika.de